



**Sub Divisional Level Water Quality Testing Laboratory**  
**UTTARAKHAND JAL SANSTHAN**  
**HALDWANI, NAINITAL**

|                                               |                                                                              |                                      |                                                                              |
|-----------------------------------------------|------------------------------------------------------------------------------|--------------------------------------|------------------------------------------------------------------------------|
| Name of the Customer/<br>Organization:        | Inspiration Senior Sec.<br>School Polysheet<br>Kathgodam<br>Distt:- Nainital | Sample Description                   | Inspiration Senior Sec.<br>School Polysheet<br>Kathgodam<br>Distt:- Nainital |
| Type of Water (Surface<br>water/Ground water) | Drinking-Water                                                               | Start of analysis<br>End of analysis | 17-04-2026<br>18-04-2026                                                     |
| Sample Code:                                  | SDLWQTML/UJS/ISS-02                                                          | Sample collected By                  | Customer                                                                     |
| Sample Receiving Date<br>and Time:            | 17.04.2026 1:30 PM                                                           | Date of Issue Report                 | 20-04-2026                                                                   |

**Water Quality Test Report**  
**Testing Details**

| S.N. | Parameters                   | Acceptable Limit<br>(As per BIS 10500-2012) | Permissible Limit<br>(in the<br>Absence of alternative<br>source)<br>(As per BIS 10500-<br>2012) | Results   |
|------|------------------------------|---------------------------------------------|--------------------------------------------------------------------------------------------------|-----------|
| 1    | Colour (Hazen units)         | 5                                           | 15                                                                                               | 1         |
| 2    | Odour (Agreeable)            | Agreeable                                   | Agreeable                                                                                        | Agreeable |
| 3    | pH@25*c                      | 6.5 to 8.5                                  | No relaxation                                                                                    | 7.93      |
| 4    | Alkalinity as CaCo3 (mg/l)   | 200                                         | 600                                                                                              | 50        |
| 5    | Turbidity (NTU)              | 1                                           | 5                                                                                                | 2.20      |
| 6    | Total dissolved solid (mg/l) | 500                                         | 2000                                                                                             | 59.9      |
| 7    | Chloride (mg/l)              | 250                                         | 1000                                                                                             | 7.8       |
| 8    | Total hardness (mg/l)        | 200                                         | 600                                                                                              | 60        |
| 9    | Calcium(as ca) (mg/l)        | 75                                          | 200                                                                                              | 12        |
| 10   | Magnesium (mg/l)             | 30                                          | 100                                                                                              | 7.29      |
| 11   | Total coliform (MPN/100ML)   | ABSENT                                      | ABSENT                                                                                           | ABSENT    |
| 12   | E.Coli (MPN/100ML)           | ABSENT                                      | ABSENT                                                                                           | ABSENT    |

CHEMIST,  
( Surendra Singh )

SDLWQTML,

UJS Haldwani (Nainital) Level

Water Quality Testing & Monitoring Laboratory,  
UJS- Haldwani ( Nainital )

TECHNICAL MANAGER  
In Charge of Laboratory  
Sub- Divisional Level  
Water Quality Testing  
& Monitoring Laboratory  
UJS- Haldwani (Nainital)





जल संवर्धन-जीवन संवर्धन

दूरभाष/फैक्स नं० 0135946-120776

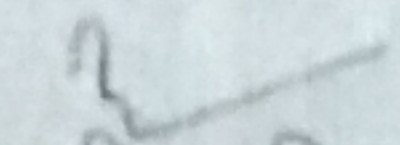
E-mail- [uvajshakti@gmail.com](mailto:uvajshakti@gmail.com)

कार्यालय अधिशासी अभियन्ता, उत्तराखण्ड जल संस्थान, हल्द्वानी

प्रमाण पत्र

प्रमाणित किया जाता है कि INSPIRATION PUBLIC SCHOOL, पौलीसीट, काठगोदाम, जिला नैनीताल (उत्तराखण्ड) में उत्तराखण्ड जल संस्थान, हल्द्वानी द्वारा आपूर्ति किया जा रहा पानी शुद्ध एवं पीने योग्य है।

दिनांक 11.06.2025

  
अधिशासी अभियन्ता  
उत्तराखण्ड जल संस्थान  
हल्द्वानी